

**1997 AMENDMENTS TO
SEWER SYSTEM RULES AND REGULATIONS**

1. Section 912 of the Sewer System Rules and Regulations dated July 23, 1990, is amended to provide that six-inch (6") pipe shall be laid on a minimum grade of one-eighth inch (1/8") per foot and four-inch (4") pipe shall be laid on a minimum grade of one-fourth inch (1/4") per foot.

2. Section 913.1 is added to the Sewer System Rules and Regulations dated July 23, 1990, as follows:

Section 913.1. The Supervisors may from time to time approve one or more drawings, sketches or examples of a typical sewer connection. Notwithstanding the other provisions hereof, building connections complying with an approved sketch or plan of a typical sewer connection shall be acceptable, provided that any matter not fully covered by such sketch or plan of a typical sewer connection shall be in accord with the terms of these Rules and Regulations and further provided all Authority Rules and Regulations are complied with. As an example, the Supervisors hereby adopt as a sketch or plan of a typical sewer connection the sketch attached hereto as Exhibit A until such time as the Supervisors shall, by resolution, replace said sketch with a different sketch. This provision is subject to the overriding provisions of Section 7 of Ordinance No. 80, as added by Section 1 of Ordinance No. 86, providing for compliance with the Sewer System Rules and Regulations of the Windber Area Authority.


3. References in the Rules and Regulations to "initial service charge" shall be interpreted to mean "initial service charge, if any, and Township connection fees, customer facilities fees, tapping fees, and inspection fees, if any."

CERTIFICATION


Now, this 4th day of August, 1997, I hereby certify that the foregoing 1997 Amendments to Sewer System Rules and Regulations dated July 1, 1997, were duly adopted by Ordinance of the Township of Paint, which Ordinance was also duly adopted.



Richard W. Seese, Secretary

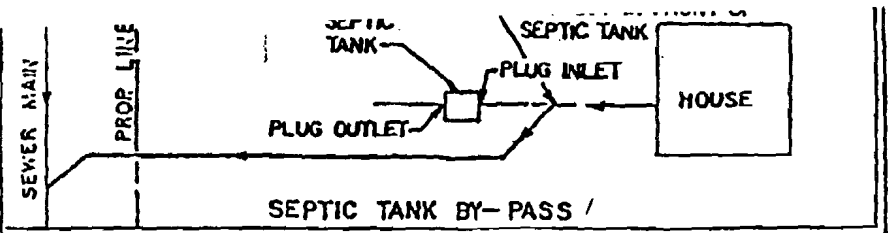

- NOTES:
1. 45° BENDS SHALL BE USED EXCEPT FOR THE ASSEMBLY OF THE HOUSE TRAP
 2. ALL PIPE TO BE SCHEDULE 40 P.V.C. OR ASTM D-3034 SDR 35.
 3. NO CONNECTIONS TO BE MADE INTO VIEW PORT OR VENT.
 4. ALL VIEW PORTS AND VENTS, TO BE SET PLUMB.

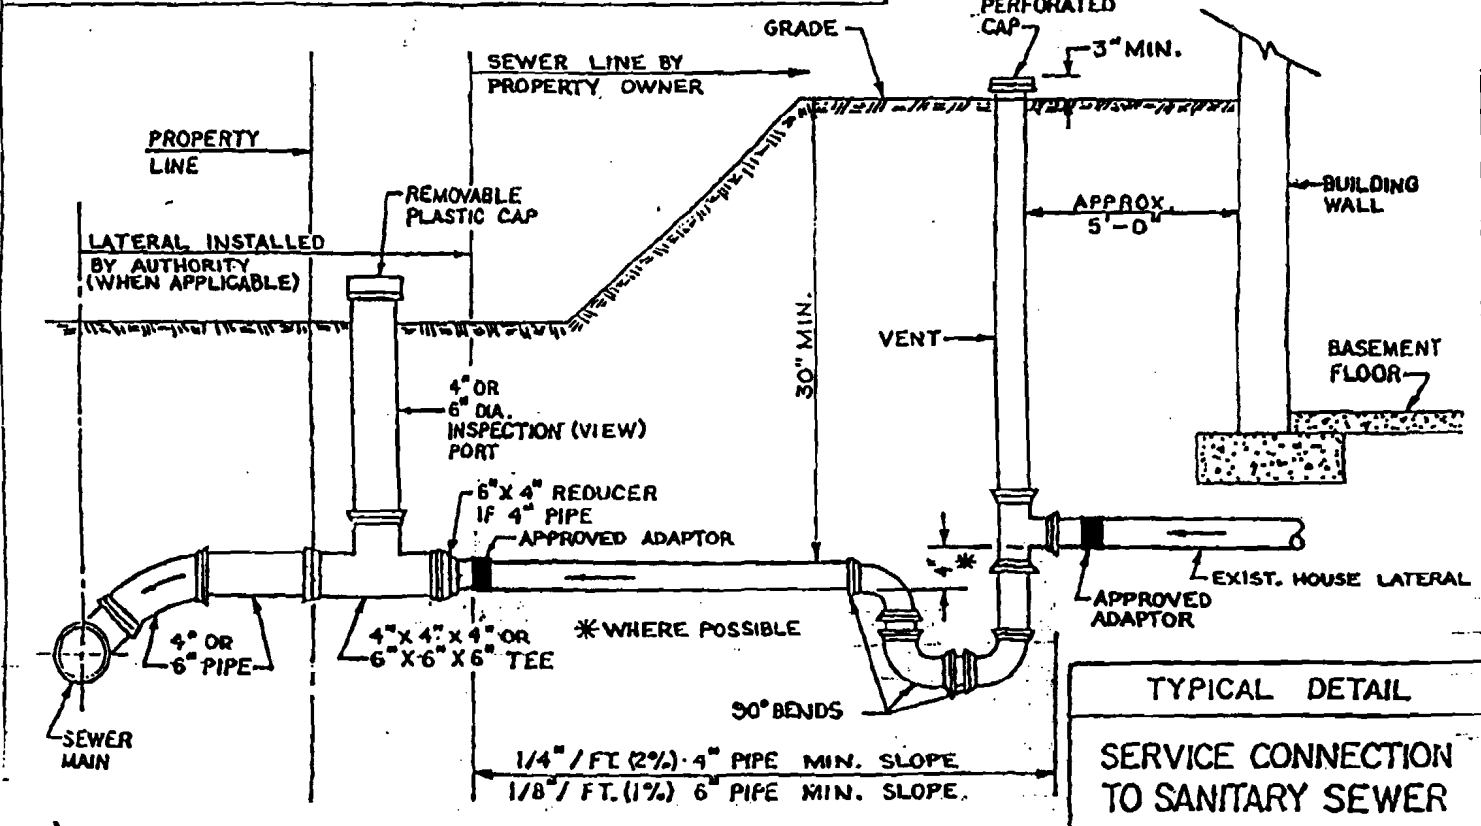

TYPICAL SEWER CONNECTION
N.T.S.

DATE REVISED: 2-10-95

TYPICAL DETAIL
SERVICE CONNECTION
TO SANITARY SEWER

PLATE I

Exhibit A